
Disconnect Terminal Blocks for Test and Measurement of Transformer Circuits, 282 Series

Preparing the shorting path for the current transformer




Insertion of insulated, touchproof adjacent jumpers into the protected shorting position.

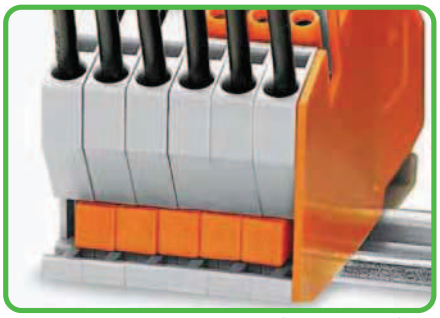


Terminal strip permanently prepared for current transformer circuits.

Lock-out

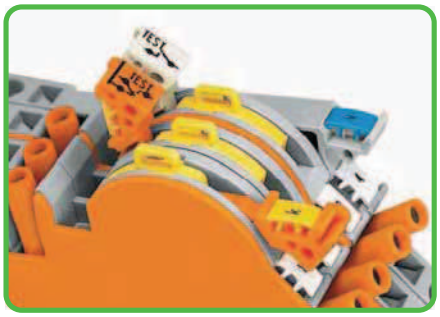

Lock-out has "snap" action into two notched positions preventing accidental operation of the disconnect link.

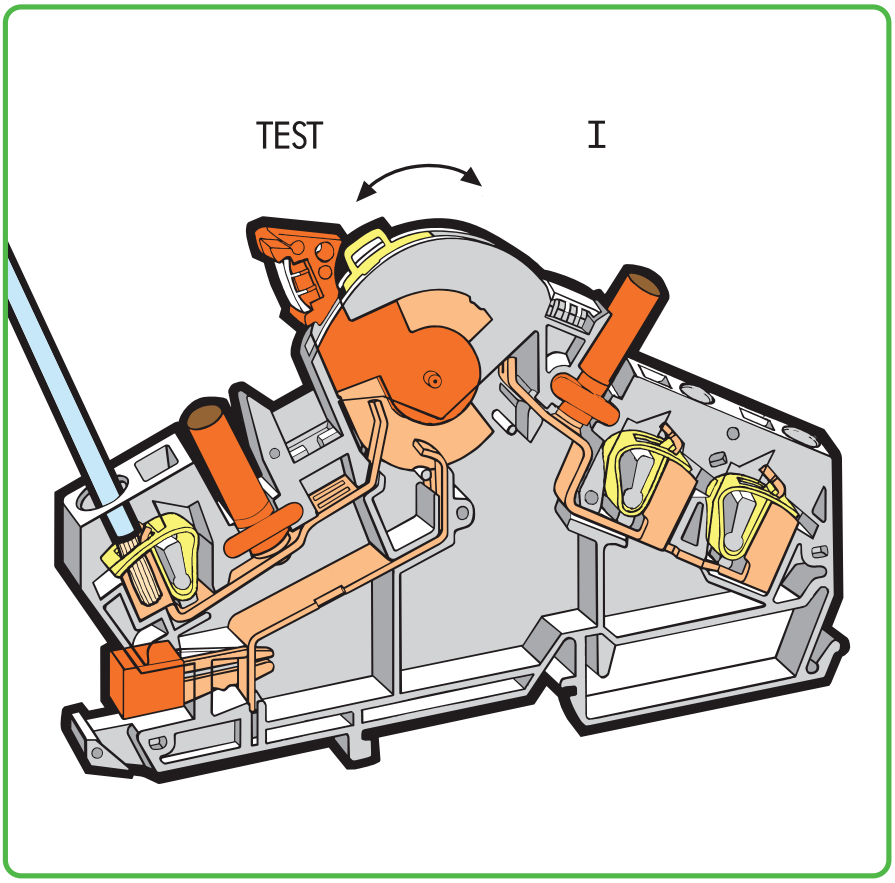


Locking cover for disconnect links




Transparent locking cover for 1 – 4 disconnect links can be snapped on
a) for mechanical interlocking for multipole switching
b) for protecting markers.

Interlocking link

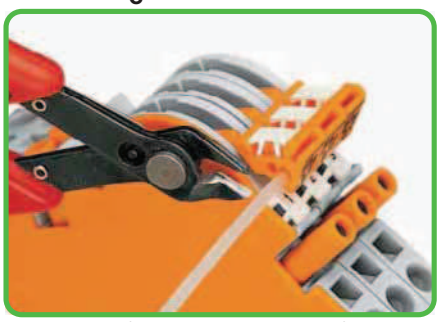


Interlocking link for mechanical interlocking of several links for multipole switching.

Touch-proof test sockets

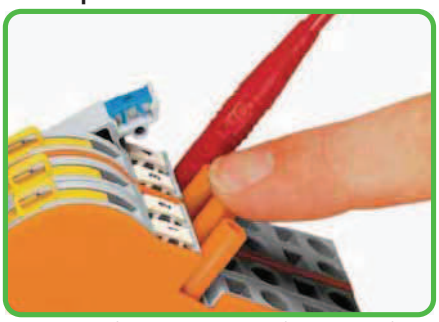

For touch-proof test sockets 4 mm Ø, for example mfd by Multi-Contact (not offered by WAGO).

Marking

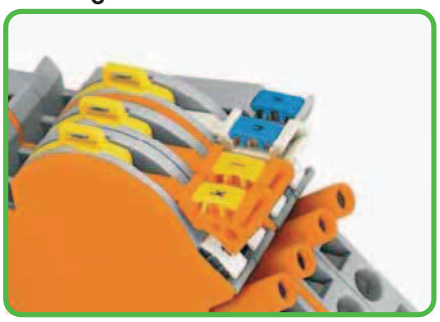

Marking with WMB Multi marking system.
For other systems, see Section 13.



CAGE CLAMP® clamps the following copper conductors:*

solid



stranded





fine-stranded, also with tinned single strands

* For aluminum conductors, see notes in Section 14.

– Description and Handling –

Disconnect link in notched position "I"

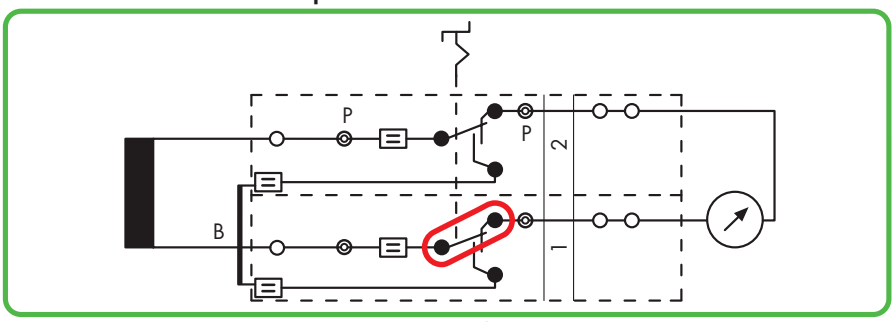


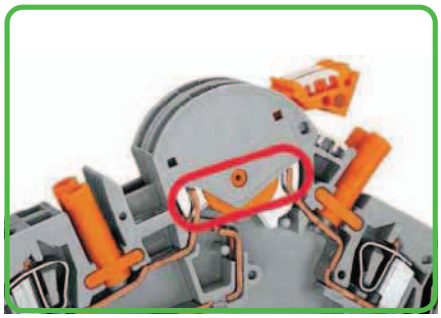


In position "I", the measuring instrument is connected to the transformer secondary.

B = shorting jumper, P = test socket


Disconnect link in transition from "I" –> "TEST" (terminal blocks 1 + 2)

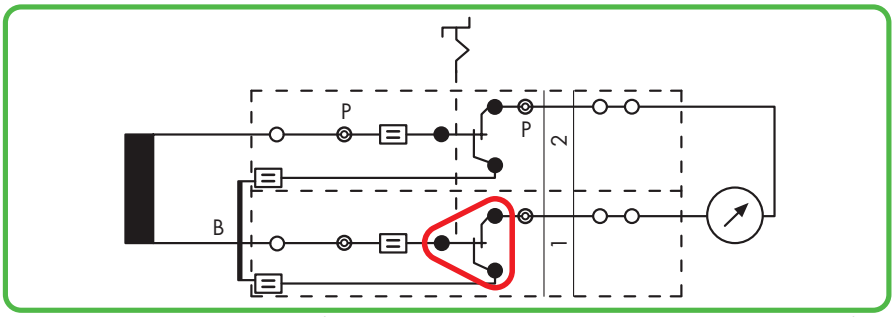


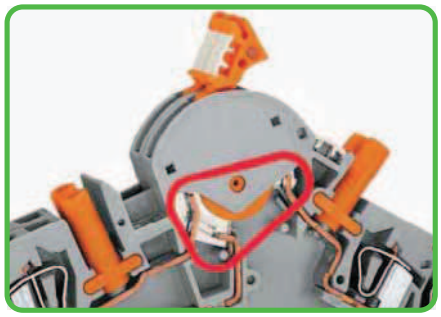

By moving the interlocked disconnect links from "I" to "TEST" the shorting path is activated without disconnection of the measuring instrument yet.


Disconnect link in notched position "TEST" (terminal blocks 1 + 2)

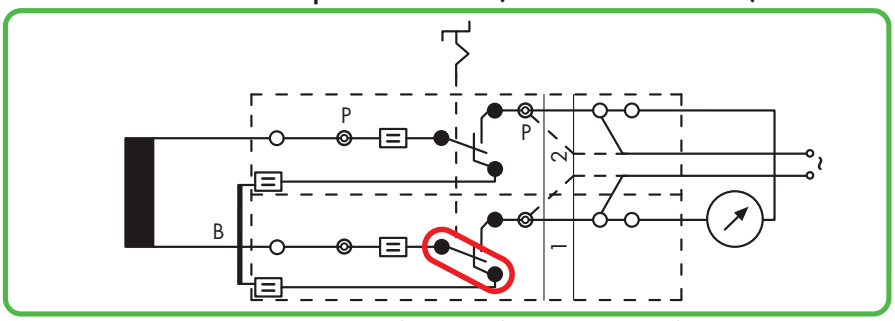


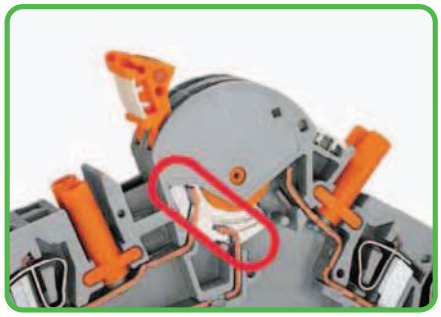

The measuring instrument is electrically disconnected from the transformer. In this position, if necessary, external voltage can be applied via sockets, or the 2nd CAGE CLAMP® connection for relay testing in transformer protection circuits.

Disconnect link in notched position "I" (terminal block 2)
Disconnect link in notched position "TEST" (terminal block 1)

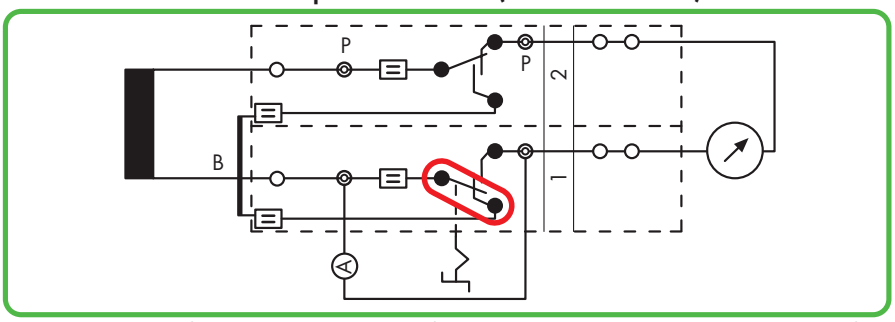

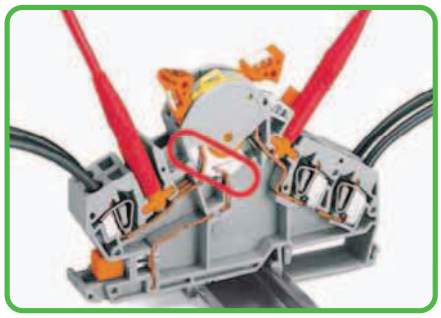

Measurement testing. Before moving the disconnect link of terminal block 1 into the notched position "TEST", the reference current meter must be inserted into the test socket of terminal block 1.



fine-stranded, tip-bonded



fine-stranded, with ferrule ❶ (gastight crimped)




fine-stranded, with pin terminal (gastight crimped)

❶ When using ferrules, the max. conductor cross section accommodated is one size smaller than max. rating of terminal block.


Circuit Configuration Examples

CAGE CLAMP® connection

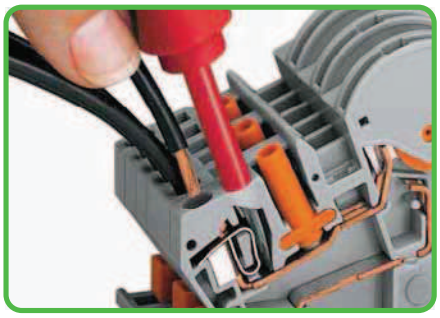


Conductor termination with operating tool (5.5 x 0.8) mm

Additional CAGE CLAMP®-connection

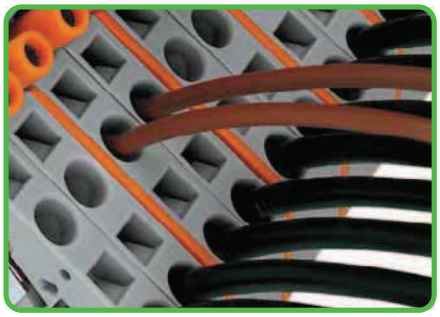


Additional CAGE CLAMP® connection on the side of the measuring instrument. For example: connecting wire commoning chains or applying an external voltage.

Commoning

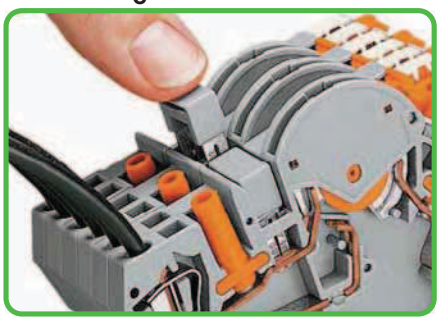


Additional commoning possible with adjacent jumper or testing option via 209-170 test plug adapter on transformer side.

Lock-out seal

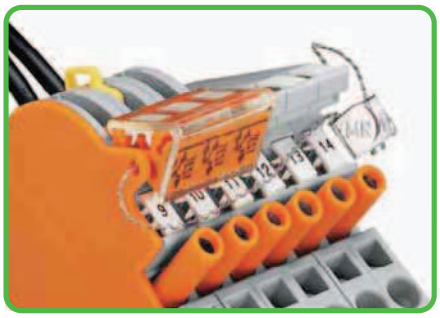


A lock-out seal can be used on the disconnect link in notched position "I".

Measuring set for a single-phase current transformer

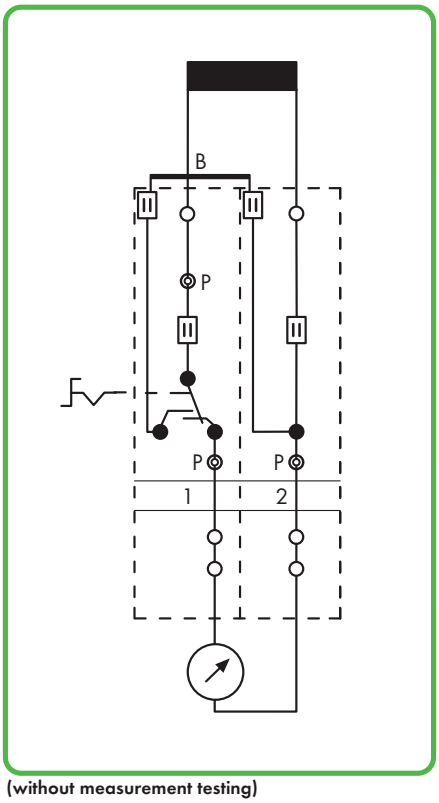

(without measurement testing)

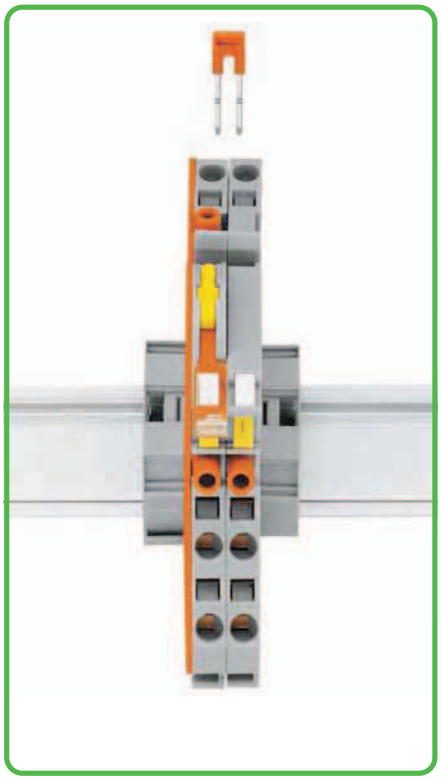



Terminal blocks required:

1 x disconnect/test terminal block	282-870
1 x through terminal block	282-865
1 x jumper, orange	282-424
1 x end plate, orange	282-386

in addition locking cover, lock-out

Measuring set for a single-phase voltage transformer

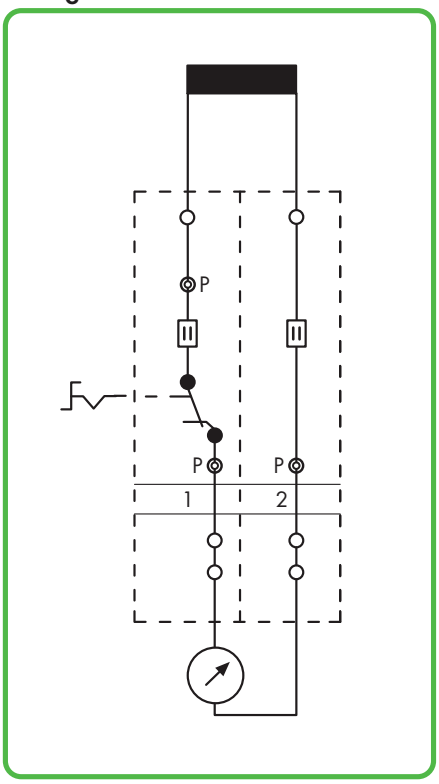

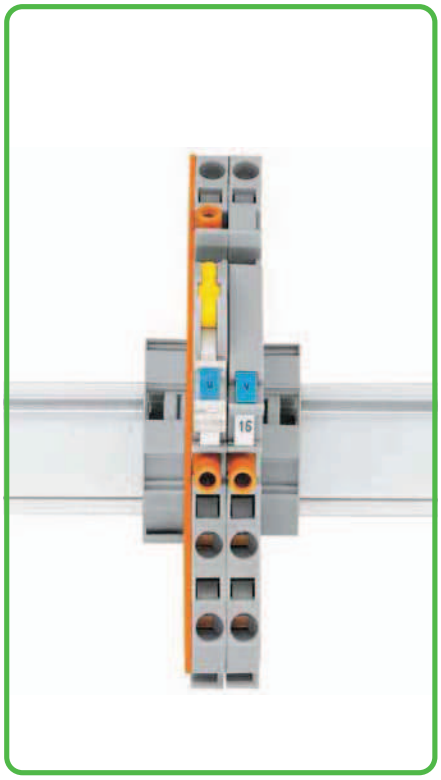



Terminal blocks required:

1 x disconnect/test terminal block	282-860
1 x through terminal block	282-866
1 x jumper, orange	282-424
1 x end plate, orange	282-386

in addition locking cover, lock-out

Measuring set for a 3-phase current transformer

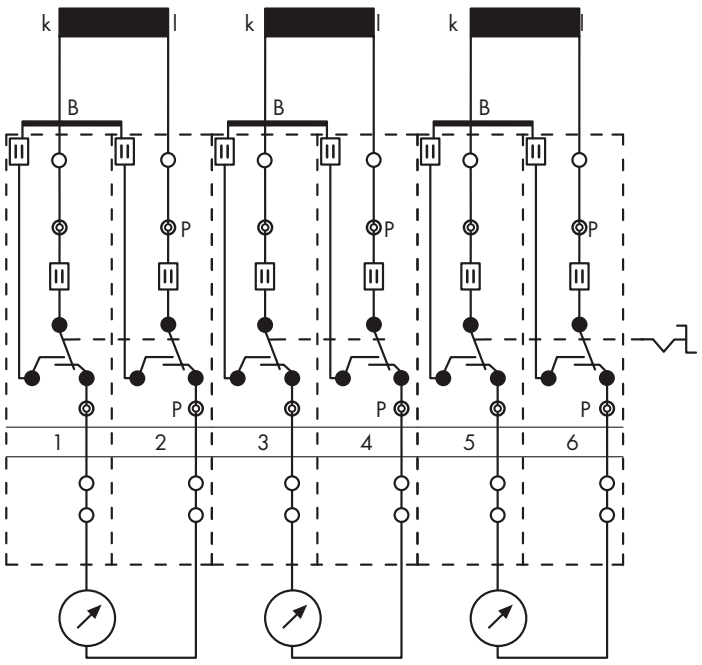

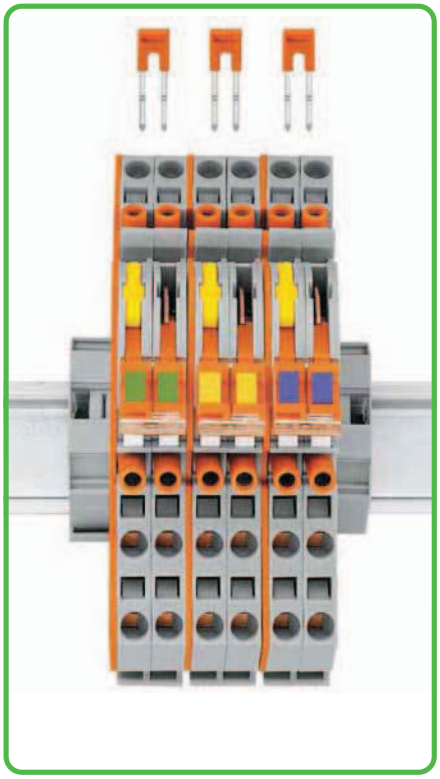

Pairs of disconnect links are interlocked by locking covers.
After the interlocking has been released, testing of the measured value is also possible.


B = shorting jumper, P = test socket


Terminal blocks required:

6 x disconnect/test terminal block	282-870
3 x jumper, orange	282-424
3 x end plate, orange	282-386

in addition locking links, locking covers, lock-outs

Measuring set for a 3-phase current transformer with 'Y' point

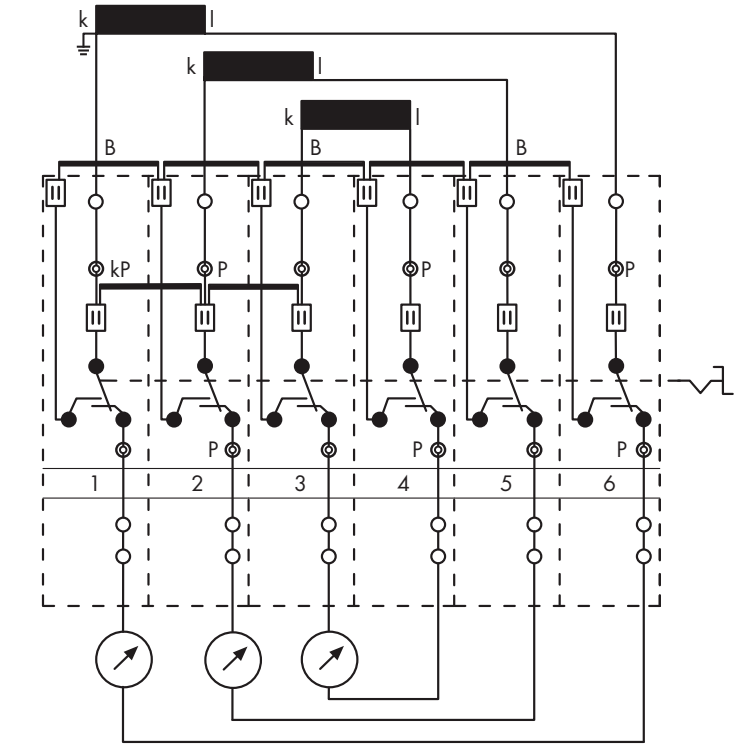

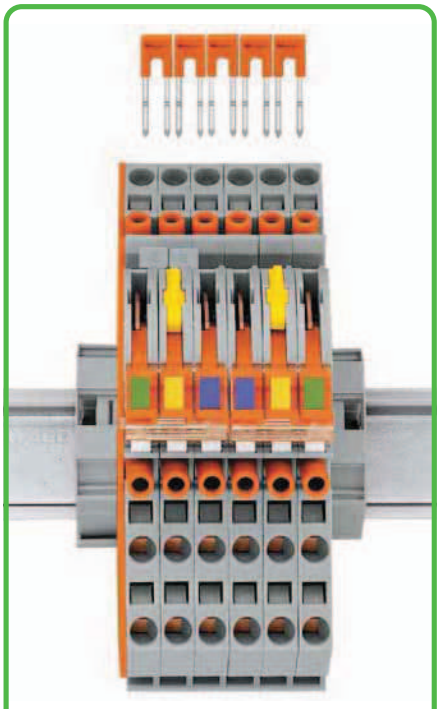

All 6 disconnect links are interlocked by the interlocking link.

kP = 'Y' point jumpers


Terminal blocks required:

6 x disconnect/test terminal block	282-870
5 x jumper, orange	282-424
2 x jumper, gray	282-402
1 x end plate, orange	282-386


in addition locking links, locking covers, lock-outs

Disconnect Terminal Blocks for Test and Measurement, 6 mm²/30 A, Through Terminal Blocks for Current and Voltage Transformer Circuits 282 Series


0.2 - 6 mm²	AWG 24 - 10	
500 V/6 kV/3 ❶	600 V, 30 A	
I_N 30 A	300 V, 5 A	
Terminal block width 8 mm / 0.315 in		
12 - 13 mm / 0.49 in ❷		

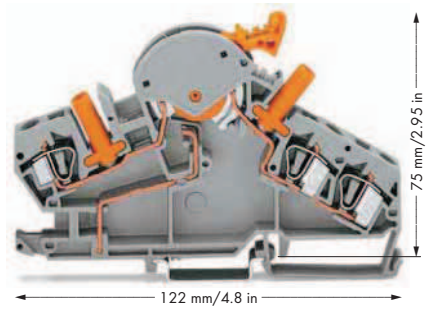

0.2 - 6 mm²	AWG 24 - 10	
500 V/6 kV/3 ❶	600 V, 30 A	
I_N 30 A	300 V, 5 A	
Terminal block width 8 mm / 0.315 in		
12 - 13 mm / 0.49 in ❷		

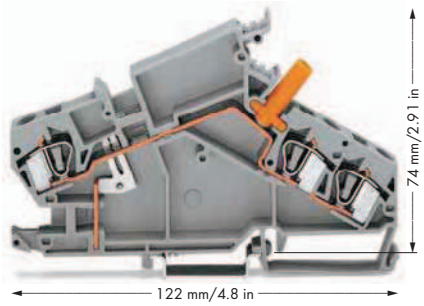

0.2 - 6 mm²	AWG 24 - 10	
500 V/6 kV/3 ❶	600 V, 30 A	
I_N 30 A	300 V, 5 A	
Terminal block width 8 mm / 0.315 in		
12 - 13 mm / 0.49 in ❷		

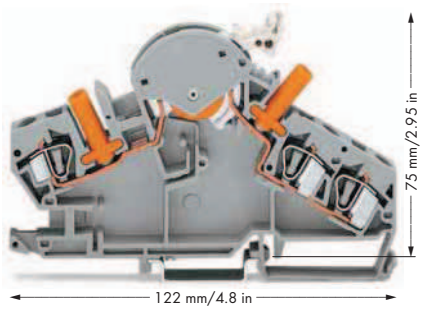

	Item No.	Pack. Unit
Disconnect terminal block for test and measurement, e.g., current transformer circuits, with touch-proof test sockets, orange disconnect link		
gray	**282-870** ❸ ❹	20

Item-Specific Accessories

End and separator plate, 1.5 mm thick, without use of lock-out seal			
	orange	**282-386**	50 (5x10)
	gray	**282-391**	50 (5x10)
End and separator plate, 1.5 mm thick, for use of lock-out seal			
	orange	**282-387**	50 (5x10)
	gray	**282-392**	50 (5x10)
Lock-out, for disconnect link			
	yellow	**282-384**	100 (5x20)
Locking cover, transparent, mechanically locks multiple links			
	1-pole	**282-881**	50 (5x10)
	2-pole	**282-882**	50 (5x10)
	3-pole	**282-883**	50 (5x10)
	4-pole	**282-884**	50 (5x10)
	5-pole	**282-885**	50 (5x10)
	6-pole	**282-886**	50 (5x10)
	7-pole	**282-887**	50 (5x10)
	8-pole	**282-888**	50 (5x10)
Interlocking link, mechanically locks multiple links, 1 m/3'3" long			
	transparent	**210-254**	1
Adjacent jumper, insulated, I_N 41 A			
	orange	**282-424**	100 (4x25)
WMB Multi marking system, 10 strips with 10 markers per card, for terminal widths 5 - 17.5 mm, yellow			
	k/l (50x)	**794-5553/000-002**	5

	Item No.	Pack. Unit
Through terminal block, e.g., current transformer circuits, with touch-proof test socket		
gray	**282-865** ❹	20

Item-Specific Accessories

End and separator plate, 1.5 mm thick			
	orange	**282-385**	50 (5x10)
	gray	**282-390**	50 (5x10)
WMB Multi marking system, 10 strips with 10 markers per card, for terminal widths 5 - 17.5 mm, yellow			
	k/l (50x)	**794-5553/000-002**	5

	Item No.	Pack. Unit
Disconnect terminal block for test and measurement, e.g., voltage transformer circuits, with touch-proof test sockets, light gray disconnect link		
gray	**282-860** ❸ ❹	20

Item-Specific Accessories

End and separator plate, 1.5 mm thick, without use of lock-out seal			
	orange	**282-386**	50 (5x10)
	gray	**282-391**	50 (5x10)
End and separator plate, 1.5 mm thick, for use of lock-out seal			
	orange	**282-387**	50 (5x10)
	gray	**282-392**	50 (5x10)
Lock-out, for disconnect link			
	yellow	**282-384**	100 (5x20)
Locking cover, transparent, mechanically locks multiple links			
	1-pole	**282-881**	50 (5x10)
	2-pole	**282-882**	50 (5x10)
	3-pole	**282-883**	50 (5x10)
	4-pole	**282-884**	50 (5x10)
	5-pole	**282-885**	50 (5x10)
	6-pole	**282-886**	50 (5x10)
	7-pole	**282-887**	50 (5x10)
	8-pole	**282-888**	50 (5x10)
Interlocking link, mechanically locks multiple links, 1 m/3'3" long			
	transparent	**210-254**	1
WMB Multi marking system, 10 strips with 10 markers per card, for terminal widths 5 - 17.5 mm, blue			
	U/V (50x)	**794-5554/000-006**	5


For list of approvals and user guide, see pages 634 to 637.


0.2 - 6 mm²	AWG 24 - 10
500 V/6 kV/3 ❶	600 V, 30 A
I_N 30 A	300 V, 5 A

Terminal block width 8 mm / 0.315 in
12 - 13 mm / 0.49 in ❷

0.2 - 6 mm²	AWG 24 - 10

Terminal block width 8 mm / 0.315 in
12 - 13 mm / 0.49 in ❷

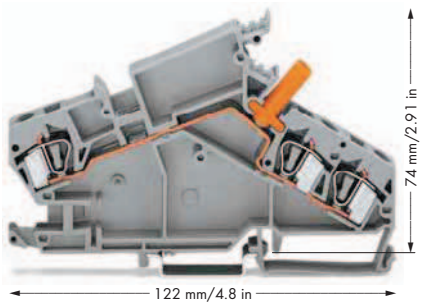

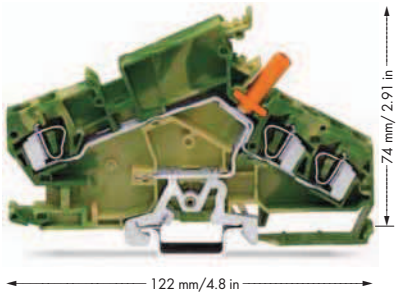

❶ 500 V = rated voltage
6 kV = rated surge voltage
3 = pollution degree
(also see Section 14)

❷ Strip length, see packaging or instructions.

❸ Max. height when rotating the disconnect link (incl. locking cover): 92 mm/3.62 in

❹ For operating stickers, please refer to our online catalog:
for 282-870: Item No. 210-412
for 282-865: Item No. 210-415
for 282-860: Item No. 210-414
for 282-866: Item No. 210-413

	Item No.	Pack. Unit
Through terminal block,		
e.g., voltage transformer circuits,		
with touch-proof test socket		
gray	**282-866** ❹	20

	Item No.	Pack. Unit
Ground terminal block,		
e.g., voltage transformer circuits,		
with touch-proof test socket		
green-yellow	**282-868** ❹	20

Item-Specific Accessories

End and separator plate,



1.5 mm thick

orange	**282-385**	50 (5x10)
gray	**282-390**	50 (5x10)

WMB Multi marking system,



10 strips with 10 markers per card,
for terminal widths 5 - 17.5 mm,
blue
U/V (50x) **794-5554/000-006**
5

Item-Specific Accessories

End and separator plate,



1.5 mm thick

orange	**282-385**	50 (5x10)
gray	**282-390**	50 (5x10)

282 Series Accessories

Appropriate marking systems
(see Section 13)

Adjacent jumper, insulated,



I_N 41 A
gray **282-402** 100 (4x25)

Alternate jumper, insulated,



I_N 41 A
gray **282-409** 100 (4x25)

Protective warning marker,



with high-voltage symbol, black,
for 5 terminal blocks
yellow **282-415** 100 (4x25)

Wire commoning chain, 4 connections,



3 x 110 mm,
insulated, I_N 24 A
black **709-110** 1

Wire commoning chain, 3 connections,



2 x 120 mm,
insulated, I_N 24 A
black **709-111** 1

Wire commoning chain, 3 connections,



2 x 170 mm,
insulated, I_N 24 A
black **709-112** 1

Group marker carrier,



e.g., for 282 Series transformer terminal blocks, angled
gray **209-144** 50 (2x25)

WMB Multi marking system,

10 strips with 10 markers per card,
for terminal widths 5 - 17.5 mm
plain **793-501** 5

WMB Multi marking system, plain,




10 strips with 10 markers per card,
for terminal widths 5 - 17.5 mm

yellow	**793-501/000-002**
red	**793-501/000-005**
blue	**793-501/000-006**
gray	**793-501/000-007**
orange	**793-501/000-012**
light green	**793-501/000-017**
green	**793-501/000-023**
violet	**793-501/000-024**

5


Transverse Switching Terminal Blocks and Longitudinal Switching Disconnect Terminal Blocks, 282 Series – Description and Handling –

Commoning

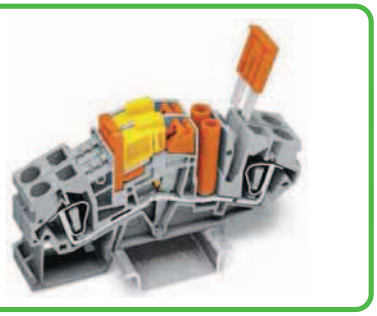


Transverse switching terminal blocks
Left: Adjacent jumper for commoning of switch lever
Right: Commoning with orange jumper

Switch positions

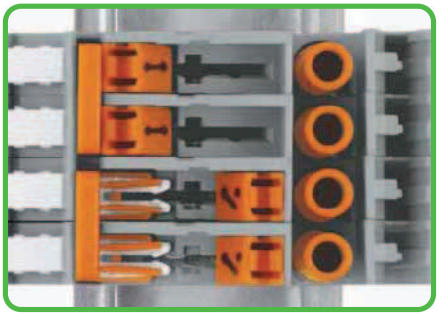


Left: closed
Right: open

Current transformer circuit




via transverse switching terminal blocks
a = Normal operation **b** = Measurement testing
c = Transformer short-circuit


Testing

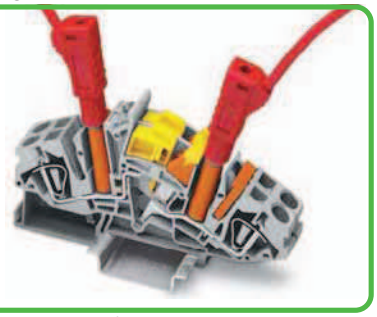


Testing with touch-proof test sockets 4 mm Ø.
(not offered by WAGO)
e.g., mfd by Multi-Contact Deutschland GmbH

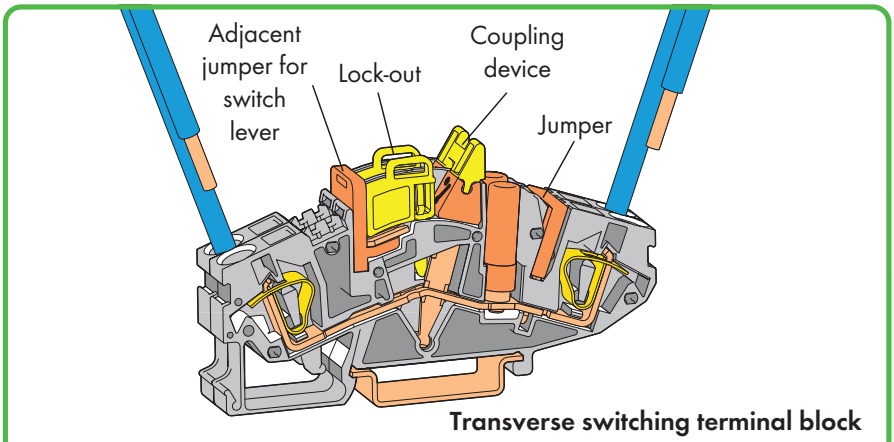


CAGE CLAMP® connection

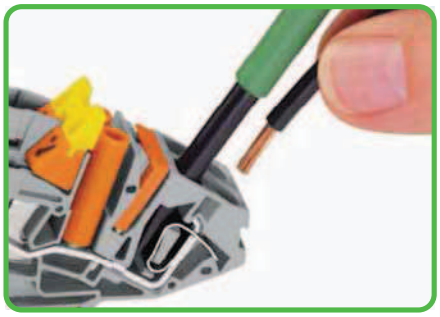

Conductor termination

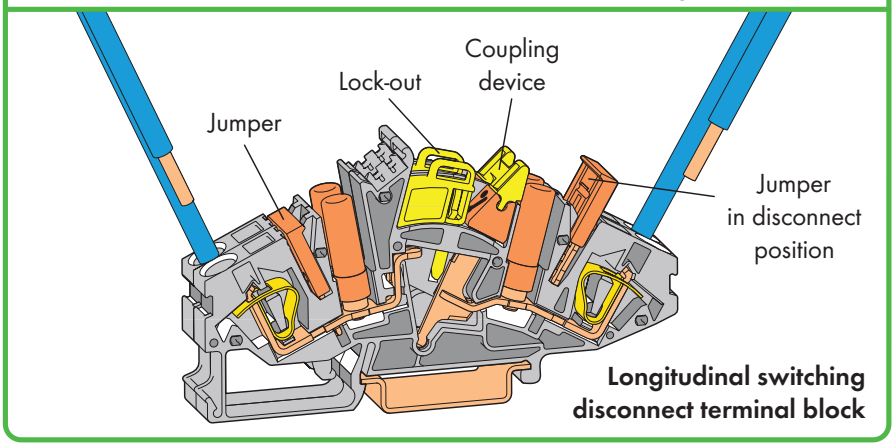


Lock-out

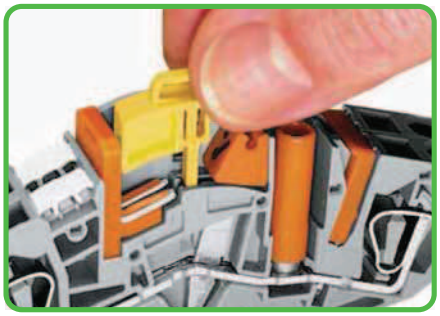


Inserting lock-out.

Commoning

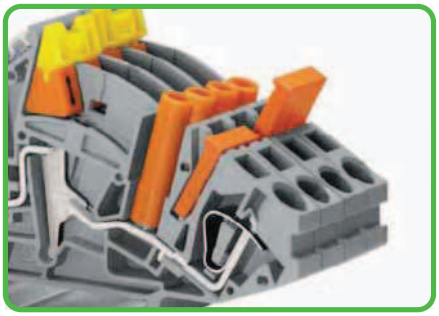

Longitudinal switching disconnect terminal blocks

Current transformer circuit



via longitudinal switching disconnect terminal blocks
a = Normal operation **b** = Measurement testing
c = Transformer short-circuit **d** = Relay test


CAGE CLAMP® clamps the following copper conductors:*

solid	stranded	fine-stranded, also with tinned single strands	fine-stranded, tip-bonded	fine-stranded, with ferrule ❶ (gastight crimped)	fine-stranded, with pin terminal (gastight crimped)


* For aluminum conductors, see notes in Section 14.

❶ When using ferrules, the max. conductor cross section accommodated is one size smaller than max. rating of terminal block.


Jumpers with Safety Lid for Longitudinal Switching Disconnect Terminal Blocks Series 282

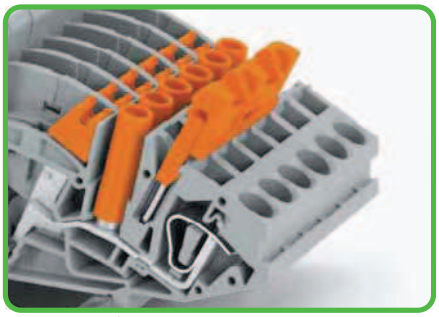


Jumper with safety lid
– Jumper in pre-latching position

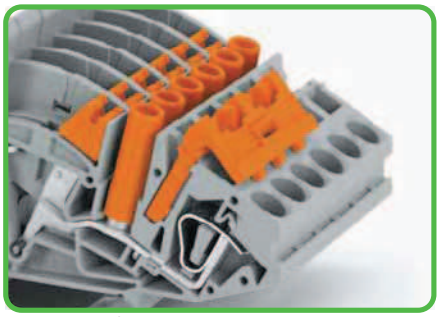

Jumper with safety lid
Longitudinal switching disconnect terminal blocks with inserted jumper, including safety lid

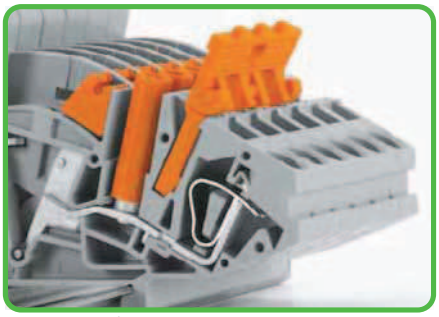


Jumper with safety lid
– Jumper with raised safety lid

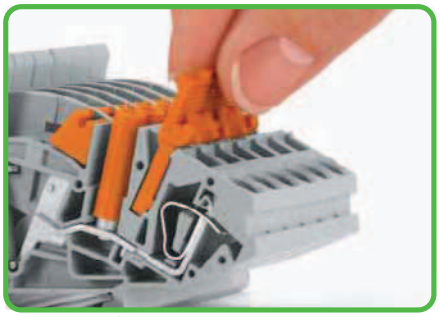



Jumper with safety lid
– Removing jumper via safety lid

Transverse Switching Terminal Blocks and Longitudinal Switching Disconnect Terminal Blocks 6 mm², e.g., Current Transformer Circuits, 282 Series

0.2 - 6 mm² | AWG 24 - 10 500 V/6 kV/3 ❶ | 600 V, 30 A I_N 30 A | 300 V, 36 A Terminal block width 8 mm / 0.315 in 12 - 13 mm / 0.49 in ❷	0.2 - 6 mm² | AWG 24 - 10 500 V/6 kV/3 ❶ | 600 V, 30 A I_N 30 A | 300 V, 36 A Terminal block width 8 mm / 0.315 in 12 - 13 mm / 0.49 in ❷	0.2 - 6 mm² | AWG 24 - 10 500 V/6 kV/3 ❶ I_N 30 A Terminal block width 8 mm / 0.315 in 12 - 13 mm / 0.49 in ❷

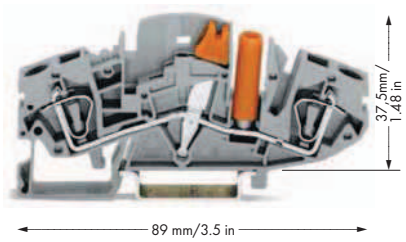

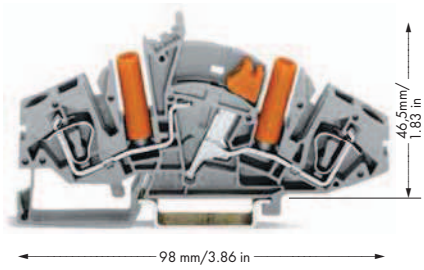

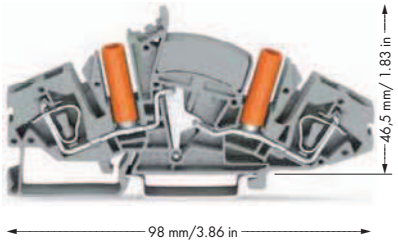

Item No.	Pack. Unit
2-conductor transverse switching terminal block, with touch-proof test socket, for test plug 4 mm Ø	
◯ gray **282-811** ❸	20

Item No.	Pack. Unit
2-conductor longitudinal switching disconnect terminal block, with touch-proof test sockets, for test plug 4 mm Ø	
◯ gray **282-821** ❸	20

Item No.	Pack. Unit
2-conductor through terminal block, with touch-proof test sockets, for test plug 4 mm Ø	
◯ gray **282-841**	20

Item-Specific Accessories

End and separator plate,

1.5 mm thick		
orange	**282-366**	50 (5x10)
gray	**282-361**	50 (5x10)

Adjacent jumper for switch lever, insulated, orange,

I_N 30 A		
2-way	**282-442**	50 (5x10)
3-way	**282-443**	50 (5x10)
4-way	**282-444**	50 (5x10)
5-way	**282-445**	50 (5x10)
6-way	**282-446**	50 (5x10)

Item-Specific Accessories

End and separator plate,

1.5 mm thick		
orange	**282-365**	50 (5x10)
gray	**282-360**	50 (5x10)

Item-Specific Accessories

End and separator plate,

1.5 mm thick		
orange	**282-365**	50 (5x10)
gray	**282-360**	50 (5x10)

Accessories

Appropriate marking systems: WMB/Miniature WSB (see Section 13)

Lock-out,

for disconnect link		
yellow	**282-370**	100 (4x25)

Coupling device,

mechanically locks multiple links,		
yellow		
2-way	**282-372**	50 (5x10)
3-way	**282-373**	50 (5x10)
4-way	**282-374**	50 (5x10)

Jumper, insulated,

I_N 30 A,		
orange		
2-way	**282-432**	50 (5x10)
3-way	**282-433**	50 (5x10)
4-way	**282-434**	50 (5x10)
5-way	**282-435**	50 (5x10)
6-way	**282-436**	50 (5x10)
7-way	**282-437**	50 (5x10)
8-way	**282-438**	50 (5x10)
9-way	**282-439**	50 (5x10)
10-way	**282-440**	50 (5x10)

Protective warning marker,

with high-voltage symbol, black,		
for 5 terminal blocks		
yellow	**282-415**	100 (4x25)

Jumper, special design,

I_N 30 A,		
orange		
1-3-5	**282-435/011-000**	
1-3-5-7	**282-437/011-000**	
		50 (5x10)

Jumper with safety lid, insulated,

I_N 30 A,		
orange		
2-way	**282-432/100-000**	
3-way	**282-433/100-000**	
4-way	**282-434/100-000**	
		50 (5x10)

Collective carrier for jumpers,

for jumpers for transverse switching terminal block (282-811) and longitudinal switching disconnect terminal block (282-821)		
gray	**282-369**	25

WMB Multi marking system,

10 strips with 10 markers per card,		
for terminal widths 5 - 17.5 mm		
plain	**793-501**	5

WMB Multi marking system, plain,

10 strips with 10 markers per card,		
for terminal widths 5 - 17.5 mm		
yellow	**793-501/000-002**	
red	**793-501/000-005**	
blue	**793-501/000-006**	
gray	**793-501/000-007**	
orange	**793-501/000-012**	
light green	**793-501/000-017**	
green	**793-501/000-023**	
violet	**793-501/000-024**	
		5

For list of approvals and user guide, see pages 634 to 637.